

സർട്ടിഫിക്കറ്റ് നമ്പർ..... 66/22 HI CIK
തീയതി. 20/05/2022



പ്രൈമറി ഹെൽത്ത് സെന്റർ ചെട്ടികുളങ്ങര സാനിറ്ററി സർട്ടിഫിക്കറ്റ്/നിരാക്ഷേപ പത്രം

ചെട്ടികുളങ്ങര ഗ്രാമപഞ്ചായത്ത്..... VI-ാം വാർഡിൽ കെട്ടിട നമ്പർ..... 111
ശ്രീ/ശ്രീമതി..... വി. രാധാകൃഷ്ണൻ നായർ
വിലാസം..... അമ്പിപ്പാട്

..... ബോളി മേരി ഹെൽത്ത് സെന്റർ
എന്നയാളുടെ ഉടമസ്ഥതയിലുള്ള ബോളി മേരി ഹെൽത്ത് സെന്റർ
എന്ന പേരിലുള്ള സ്ഥാപനം..... 20/05/2022 തീയതിയിൽ നേരിട്ട് പരിശോധിച്ച് ബോധ്യപ്പെട്ടതിനാൽ സ്ഥാപനം പ്രവർത്തിപ്പിക്കുന്നതിനാവശ്യമായ സാനിറ്ററി സർട്ടിഫിക്കറ്റ് നൽകിയതായി സാക്ഷ്യപ്പെടുത്തുന്നു. പൊതുജനാരോഗ്യനിയമവും നിലവിലുള്ള മറ്റ് നിയമങ്ങളും അപേക്ഷകൻ സ്വയം സാക്ഷ്യപ്പെടുത്തി നൽകിയിരിക്കുന്ന സത്യവാങ്മൂലവും നിബന്ധനകളും പാലിക്കാതിരിക്കുന്നത് ഈ സർട്ടിഫിക്കറ്റിനെ സ്വയമേവ അസാധുവാക്കുന്നതാണ്.
..... ജി.കെ. പ്രവർത്തിച്ചിരുന്നതിന്

മുതലായവയുടെ ബിസ്സിനസ് നടത്തുന്നതിന്
ട്രേഡ് ലൈസൻസ് നൽകാവുന്നതാണ്/പുതുക്കാവുന്നതാണ്.



ഹെൽത്ത് ഇൻസ്പെക്ടർ
Mini R
ഹെൽത്ത് ഇൻസ്പെക്ടർ
കുടുംബാരോഗ്യകേന്ദ്രം
ചെട്ടികുളങ്ങര

ട്രേഡ് ലൈസൻസിനുള്ള അപേക്ഷ ജൂണിൽ ഹെൽത്ത് ഇൻസ്പെക്ടറുടെ പേഴ്സണൽ റജിസ്റ്ററിൽ ചേർത്തു.
നമ്പർ..... തീയതി.....

ജൂനിയർ ഹെൽത്ത് ഇൻസ്പെക്ടർ
ചെട്ടികുളങ്ങര സെക്ഷൻ/ഏരിയ



KERALA WATER AUTHORITY
PULIKKEEZHU, THIRUVALLA



Telephone No: 0469 2600833 Email: kwaqcsdtpkz@gmail.com

WATER ANALYSIS REPORT

LICENSE PURPOSE
 ULR - TC1025222000000319F

Report No: 2625/PLKZ/05/2022 (A)

Date: 21.05.2022

Customer Name & Address
 Holy Mary Central School
 Peringala P.O
 Kayamkulam

1. Date of Receipt	18.05.2022
2. Date of Sampling	18.05.2022
3. Time of Sampling	12.30 PM
4. Sampling done by	Customer
5. Sample Code	2022-QCSDI-PLKZ/P2769
6. Source of Sample	OPEN WELL
7. Sample Quantity	2 LITRE
8. Test performing dates	From: 19.05.2022 to 21.05.2022

Sl. No	Characteristics	Unit	Desirable limits As per IS 10500:2012	Test Method	Result
1	Colour	Pt-Co Unit	5	APHA 2120 B	2
2	Odour			IS 3025(part 5)-2018	Agreeable
3	Turbidity	(NTU)	1	IS 3025(part10)-1984	0.22
4	pH at 25°C		6.5-8.5	IS 3025(part 11)-1983	7.38
5	Alkalinity	(mg/L)	200	IS 3025(part 23)-1986	33.3
6	Total Dissolved Solids (TDS)	(mg/L)	500	IS 3025(part16)-1984	56.4
7	Total Hardness (as CaCO ₃)	(mg/L)	200	IS 3025(part21)-2009	46
8	Calcium(as Ca)	(mg/L)	75	IS 3025(part40)-1991	16.8
9	Magnesium (as Mg)	(mg/L)	30	APHA 3500 - Mg B	0.972
10	Chloride(as Cl)	(mg/L)	250	IS 3025(part32)-1988	9.72

Remarks:-

NB -The results stated above relate only to the samples submitted for testing. This test Certificate shall not be reproduced except in full with out the written approval of the Laboratory.

- Samples will be retained only for 7 days after completion of analysis

Verified By


Name: SURI S

Technical Manager

Authorized by

Name: Manu G

Deputy Quality Manager

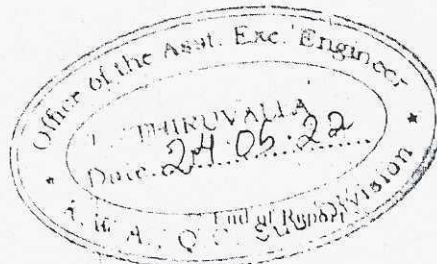

Page 1 of 1